

Test Report

FOR: **Solitrade**
Charlotte, NC

Impact Sound Transmission
RAL-IN18-016

CONDUCTED: 2018-03-21

Page 1 of 9

ON: Laminate flooring over SoliBlock Floor HP+ underlayment over 6 in. concrete slab, no ceiling

TEST METHOD

Riverbank Acoustical Laboratories™ is accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) as an ISO 17025:2005 Laboratory (NVLAP Lab Code: 100227-0) and for this test procedure. The test reported in this document conformed explicitly with ASTM E492-09: "Standard Test Method for Laboratory Measurement of Impact Sound Transmission Through Floor-Ceiling Assemblies Using the Tapping Machine." The single number rating of the specimen was calculated according to ASTM E989-06 (2012): "Standard Classification for Determination of Impact Insulation Class (IIC)." A description of the measuring procedure and room qualifications is available upon request.

DESCRIPTION OF THE SPECIMEN

The test specimen was designated by the manufacturer as Laminate flooring over SoliBlock Floor HP+ underlayment over 6 in. concrete slab, no ceiling.

The building contractor and RAL staff compiled a detailed construction specification as follows, in order of installation:

Concrete Slab

Material:	Wire-reinforced concrete
Dimensions:	4 @ 609.6 mm (24 in.) x 4267.2 mm (168 in.)
Thickness:	152.4 mm (6.0 in.)
Overall Weight:	3,467.71 kg (7,645 lbs)
Mass per Unit Area:	333.27 kg/m ² (68.26 lb/ft ²)
Installation:	The slab was isolated from the sill by rubber pads
Joints:	Underside sealed with acoustical caulk and tape Top filled with general purpose sand, sealed with ready mix compound

Test Report

Solitrade
2018-03-21

RAL-IN18-016
Page 2 of 9

Underlayment

Trade Name: SoliBlock Floor HP+
Material: Felt over vinyl sheet
Installed: Loose laid over concrete slab, felted side down
Overall Dimensions: 2438.4 mm (96 in.) x 2743.2 mm (108 in.)
Measured Thickness: 5.97 mm (0.235 in.)
Overall Weight: 40.37 kg (89 lbs)
Mass per Unit Area: 3.88 kg/m² (0.79 lb/ft²)
Joints: Sealed with tape

Floor Covering

Material: Wood-look laminate over fiberboard flooring tiles
Installed: Loose laid over underlayment
Tile Dimensions: 1290 mm (50.787 in.) x 194 mm (7.638 in.)
Tile Thickness: 6.6 mm (0.26 in.)
Overall Weight: 62.14 kg (137 lbs)
Mass per Unit Area: 5.97 kg/m² (1.22 lb/ft²)
Joints: Locking edge design

Test Report

Solitrade
2018-03-21

RAL-IN18-016
Page 3 of 9

Physical Measures

Size: 2.44 m (96.00 in.) wide by 4.27 m (168.00 in.) long
Thickness: 165.10 mm (6.50 in.)
Weight: 3570.29 kg (7871.00 lbs.)
Transmission Area: 10.40 m² (112.00 ft²)
Mass per Unit Area: 343.14 kg/m² (70.28 lbs./ft²)

Test Aperture

Size: 4.27 m (14.0 ft.) by 2.44 m (8 ft.)
Filler Wall: None
Sealed: Entire periphery (both sides) with dense mastic

Test Environment

Source Room

Volume: 132.6 m³ (4,681.0 ft³)
Temperature: 23±0°C (73±0°F)
Humidity: 50±1%

Receive Room

Volume: 81.7 m³ (2,884.3 ft³)
Temperature: 23±0°C (74±0°F)
Humidity: 52±1%

Requirements

Temperature: 22° C +/- 5° C, not more than 3° C change over all tests.
Humidity: ≥ 30% RH; not more than +/- 3% change over all tests.

Test Report

Solitrade
2018-03-21

RAL-IN18-016
Page 4 of 9



Figure 1 – Specimen mounted in test opening.



Figure 2 – Underlayment installed over concrete slab

Test Report

Solitrade
2018-03-21

RAL-IN18-016
Page 5 of 9



Figure 3 – Underside of test specimen

Test Report

Solitrade
2018-03-21

RAL-IN18-016
Page 6 of 9

TEST RESULTS

The impact sound pressure levels, normalized to 10 m², are tabulated at the sixteen standard frequencies. A graphic presentation of the data and additional information appear on the following pages. The precision of the test data is within the limits set by the ASTM Standard E989-06 (2012).

<u>FREQ.</u>	<u>Ln</u>	<u>C.L.</u>	<u>DEV</u>	<u>FREQ.</u>	<u>Ln</u>	<u>C.L.</u>	<u>DEV</u>
100	53	0.41		800	39	0.35	
125	58	0.97	3	1000	33	0.31	
160	57	0.62	2	1250	29	0.34	
200	59	0.74	4	1600	26	0.23	
250	61	0.65	6	2000	21	0.33	
315	63	0.73	8	2500	13	0.96	
400	54	0.61		3150	9	1.74	
500	52	0.48					
630	43	0.47					

IIC=57

ABBREVIATION INDEX

FREQ. = FREQUENCY, HERTZ, (cps)
Ln = NORMALIZED IMPACT SOUND PRESSURE LEVEL, dB
C.L. = UNCERTAINTY IN dB, FOR A 95% CONFIDENCE LIMIT
DEV. = DEVIATION, dB > IIC CONTOUR (SUM OF DEV = 23)
IIC = IMPACT INSULATION CLASS
* = INDICATES A CORRECTION HAS BEEN APPLIED TO DATA
DUE TO BACKGROUND NOISE LEVELS

Tested by Marc Sciaky
Marc Sciaky
Experimentalist

Report by Malcolm Kelly
Malcolm Kelly
Acoustician

Approved by Eric P. Wolfram
Eric P. Wolfram
Laboratory Manager

1512 S BATAVIA AVENUE
GENEVA, IL 60134
630-232-0104

An ALION Technical Center

RIVERBANK.ALIONSCIENCE.COM

FOUNDED 1918 BY
WALLACE CLEMENT SABINE


Test Report

Solitrade
2018-03-21

RAL-IN18-016
Page 7 of 9

IMPACT SOUND TRANSMISSION REPORT

Laminate flooring over SoliBlock Floor HP+ underlayment over 6 in. concrete slab, no ceiling

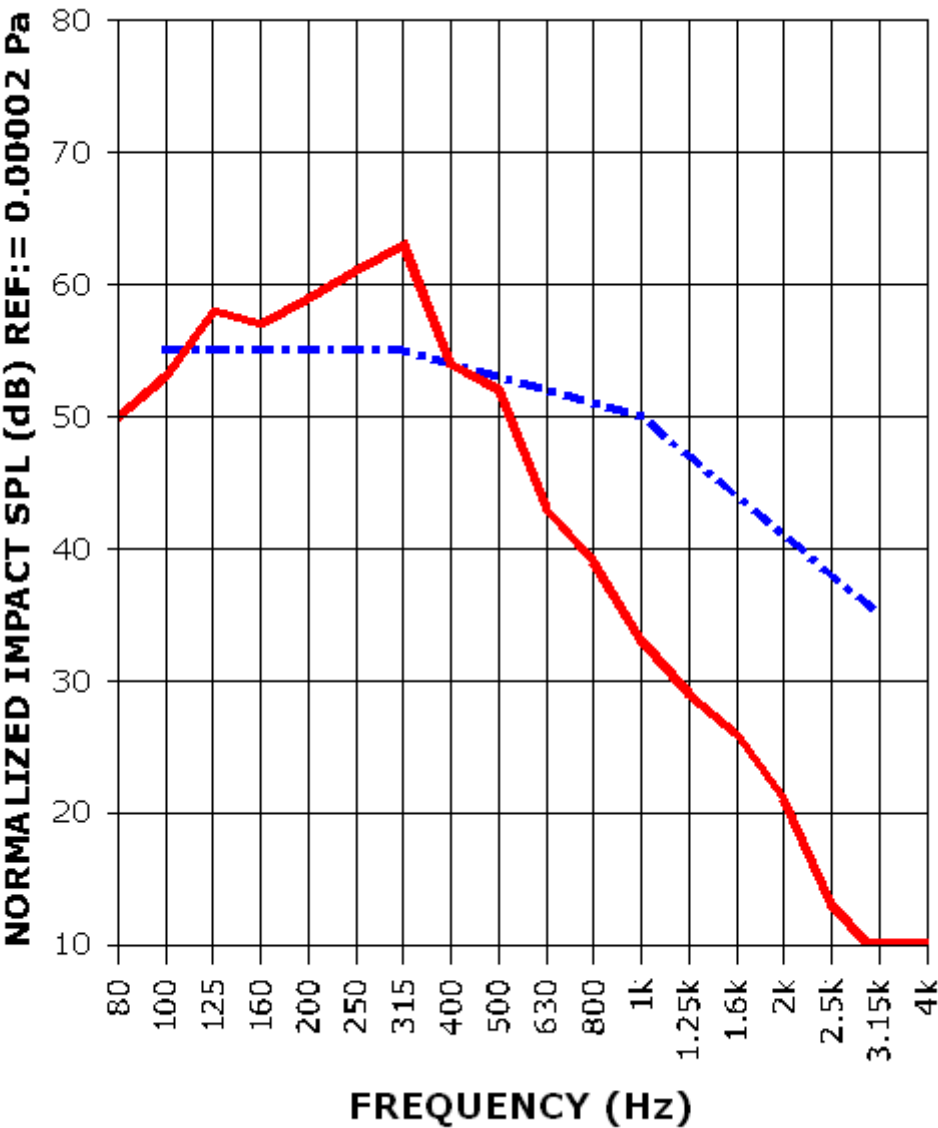

IIC=57



IMPACT SOUND PRESSURE LEVEL
IMPACT INSULATION CLASS CONTOUR

Test Report

Solitrade
2018-03-21

RAL-IN18-016
Page 8 of 9

APPENDIX A: Extended Frequency Range Data

Specimen: Laminate flooring over SoliBlock Floor HP+ underlayment over 6 in. concrete slab, no ceiling
(See Full Report)

The following non-accredited data were obtained in accordance with ASTM E989-06 (2012), but extend beyond the defined frequency range of 100Hz to 3,150Hz. These unofficial results are representative of the RAL test environment only and intended for research & comparison purposes.

1/3 Octave Band Center Frequency (Hz)	Normalized Impact Sound Pressure Level (dB)	Repeatability (95% ±)
31.5	58	1.38
40	53	2.06
50	60	0.60
63	55	1.17
80	50	0.63
100	53	0.41
125	58	0.97
160	57	0.62
200	59	0.74
250	61	0.65
315	63	0.73
400	54	0.61
500	52	0.48
630	43	0.47
800	39	0.35
1000	33	0.31
1250	29	0.34
1600	26	0.23
2000	21	0.33
2500	13	0.96
3150	9	1.74
4000	6	2.51
5000	7	2.09
6300	8	2.15
8000	10	2.02
10000	11	1.34
12500	11	1.35

Test Report**Solitrade**
2018-03-21**RAL-IN18-016**
Page 9 of 9**APPENDIX B: Instruments of Traceability**

Specimen: Laminate flooring over SoliBlock Floor HP+ underlayment over 6 in. concrete slab, no ceiling
(See Full Report)

<u>Description</u>	<u>Model</u>	<u>Serial Number</u>	<u>Date of Certification</u>	<u>Calibration Due</u>
Bruel & Kjaer Pulse Analyzer - System4	Type 3560-C	2639093	2017-08-02	2018-08-02
Bruel & Kjaer Mic And Preamp D	Type 4943-B-001	2311440	2017-09-22	2018-09-22
Bruel & Kjaer Tapping Machine-WoodCase	3204	226940	2017-07-11	2018-07-11
Bruel & Kjaer Pistonphone	Type 4228	2781248	2017-08-02	2018-08-02
EXTECH_62	SD700	A.083662	2017-11-20	2018-11-20
EXTECH_63	SD700	A.083663	2017-11-20	2018-11-20

APPENDIX C: Revisions to Original Test Report

<u>Date</u>	<u>Revision</u>
2019-08-30	Page 1-9: The original manufacturer/requester identification and specimen designation were changed to facilitate a private label sales agreement. The original requester has provided a letter to RAL on their company letterhead certifying that the product identified has not changed in materials, composition, or manufacturing methods since the original test date and the product sold under the private label agreement is exactly identical to the original specimen described in the test report and sourced from the same manufacturing process. - EPW

END